

LINEAR MOTORIZED VALVES

CONTROL VALVE PN16 SERIES SERIE VLA100

ESBE control valves series VLA100 are 2-way and 3-way internal threaded valves for PN16, DN 15-50.



MEDIA

These valves can handle the following types of media:

- Hot and cold water.
- Water with antifreeze additives such as glycol.

If the valve is used for media at temperatures below 0°C (32°F), it should be equipped with a stem heater in order to prevent ice formation on the valve stem.

OPTION

Adaptor kit _____ Siemens SQX, Art. No. 26000700


TECHNICAL DATA

Type: _____ 2- and 3-way plug valve
 Pressure class: _____ PN 16
 Flow characteristic A-AB: _____ EQM
 Flow characteristic B-AB: _____ Complementary
 Stroke: _____ 20 mm
 Rangeability Kv/Kv^{min}: _____ see graph
 Leakrate A-AB: _____ Tight sealing
 Leakrate B-AB: _____ Tight sealing
 ΔP_{max} : _____ see graph
 Media temperature: _____ max. +130°C
 min. -20°C
 Media: _____ Heating water (in accordance with VDI2035)
 Water / Glycol mixtures, max. 50%
 Water / Ethanol mixtures, max. 28%
 Connection: _____ Internal thread, EN 10226-1

Material

Body: _____ Nodular iron EN-JS 1030
 Stem: _____ Stainless steel SS 2346
 Plug: _____ Brass CW602N
 Seat: _____ Nodular iron EN-JS 1030
 Blind plug: _____ Brass CW602N
 Seat seal: _____ EPDM
 Packing box seal: _____ PTFE/EPDM

PED 2014/68/EU, article 4.3 / SI 2016 No. 1105 (UK)

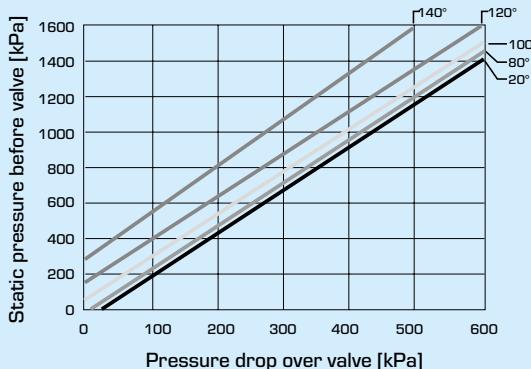

Pressure drop limit where cavitation might occur. Is dependent of valve inlet pressure and temperature of water.

CONTROL VALVE DESIGNED FOR


- Heating
- Ventilation
- Comfort Cooling
- District Heating
- Floor heating
- District Cooling
- Solar heating

SUITABLE ACTUATORS


- Series ALB140
- Series ALF26x
- Series ALF13x
- Series ALF36x

VALVE CHARACTERISTICS

2-way valves, DN15-50

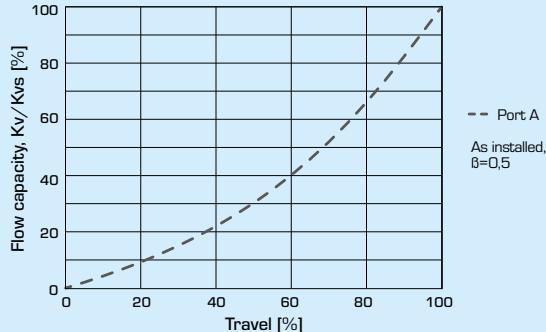


3-way valves, DN15-50

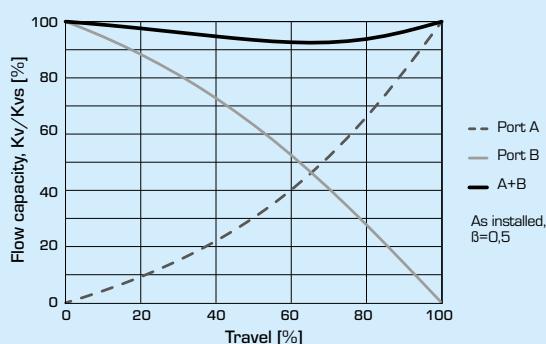


LINEAR MOTORIZED VALVES

CONTROL VALVE PN16

SERIES SERIE VLA100

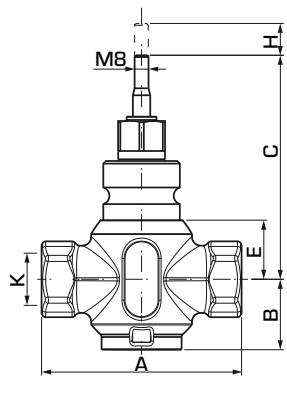

VLA121

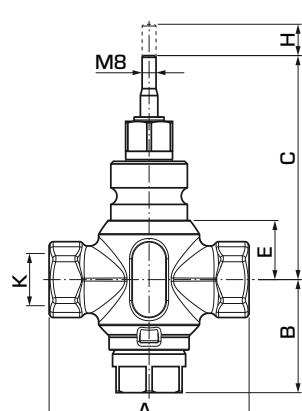

VLA131

2-WAY CONTROL VALVE SERIES VLA121

Art. No.	Reference	DN	Kvs*	A	B	C	E	H	K	Rangeability Kv/Kv ^{min}	Weight [kg]
21150100	VLA121	15	1,6	85	38	108	24	20	Rp 1½"	>50	1,0
21150200			2,5								
21150300			4								
21150400	VLA121	20	6,3	100	40	115	30	20	Rp ¾"	>50	1,2
21150500	VLA121	25	10	115	40	119	34	20	Rp 1"	>50	1,3
21150600	VLA121	32	16	130	41	120	35	20	Rp 1¼"	>50	1,8
21150700	VLA121	40	25	150	50	128	42	20	Rp 1½"	>50	2,7
21150800	VLA121	50	38	180	59	138	53	20	Rp 2"	>50	4,2

3-WAY CONTROL VALVES SERIES VLA131

Art. No.	Reference	DN	Kvs*	A	B	C	E	H	K	Rangeability Kv/Kv ^{min}	Weight [kg]
21150900	VLA131	15	1,6	85	58	108	24	20	Rp ½"	>50	1,1
21151000			2,5								
21151100			4								
21151200	VLA131	20	6,3	100	61	115	30	20	Rp ¾"	>50	1,3
21151300	VLA131	25	10	115	65	119	34	20	Rp 1"	>50	1,5
21151400	VLA131	32	16	130	70	120	35	20	Rp 1¼"	>50	2,1
21151500	VLA131	40	25	150	74	128	42	20	Rp 1½"	>50	3,0
21151600	VLA131	50	38	180	90	138	53	20	Rp 2"	>50	4,7


* Kvs-value in m³/h at a pressure drop of 1 bar.

LINEAR MOTORIZED VALVES

CONTROL VALVE PN16

SERIES SERIE VLA100

FLOW CHART

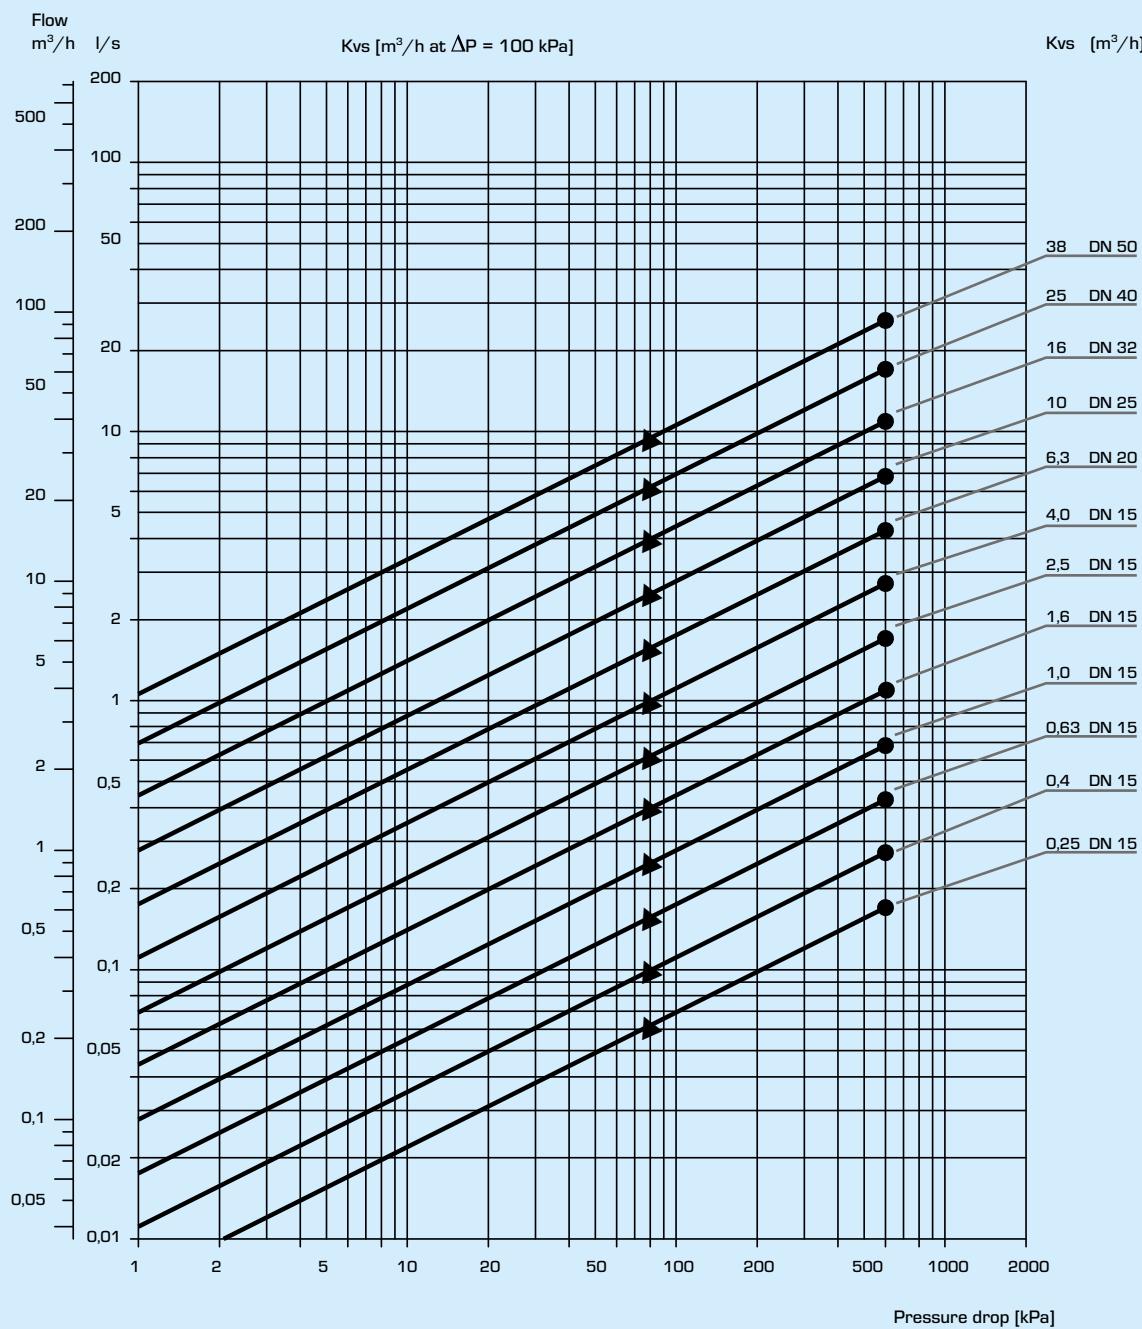

To be considered: As both the viscosity and the thermal conduction are affected when glycol is added to the system water, this fact has to be considered when dimensioning the valve.
A good rule is to choose one size higher Kv-value when 30 – 50% glycol is added. A lower concentration of glycol may be disregarded.
N.B.! Maximum 50% glycol for freezing protection and oxygen absorbing compounds are allowed as additives.

CONTROL VALVE PN16

SERIES SERIE VLA100

INSTALLATION

The valve should be mounted with flow direction in accordance with the valve marking.

If possible, the valve should be installed in the return pipe, in order to avoid exposing the actuator to high temperatures.

The valve must not be installed with the actuator mounted below the valve.


Mounting positions:

A = Allowed mounting position with fluid temperature between -20°C to +120°C.

B = Allowed mounting position with fluid temperature between 0°C to +150°C.

C = Not allowed mounting position.

To ensure that suspended solids will not become jammed between the valve plug and seat, a filter should be installed upstream of the valve, and the pipe system should be flushed before the valve is installed.

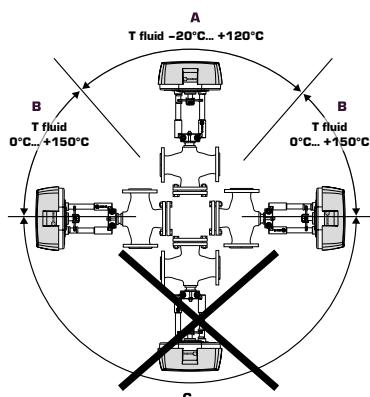

VALVE AUTHORITY [β]

Δp_v - pressure losses over the valve [bar]

Δp_{sys} - pressure losses over the system with variable flow [bar]

Δp_{inst} - pressure losses over the installation [bar]

Recommendation : Valve authority [β] shall be between 0.3 to 0.7

a) 2-way valve


$$\beta = \frac{\Delta p_v}{\Delta p_v + \Delta p_{inst}}$$

b) 3-way valve


$$\beta = \frac{\Delta p_v}{\Delta p_v + \Delta p_{sys}}$$

INSTALLATION EXAMPLES

2-WAY CONTROL VALVES

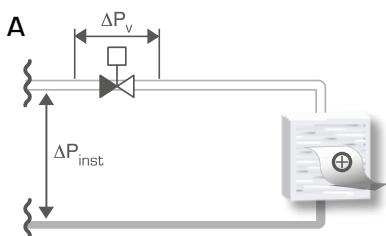


Installation without local circulating pump

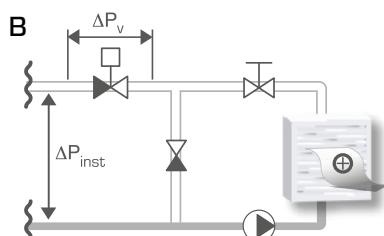


Installation with local circulation pump


3-WAY CONTROL VALVES

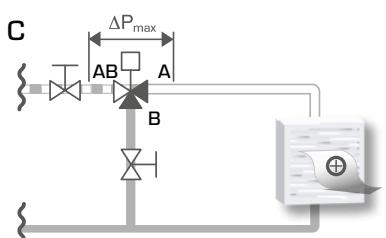

Circuit without local circulation pump

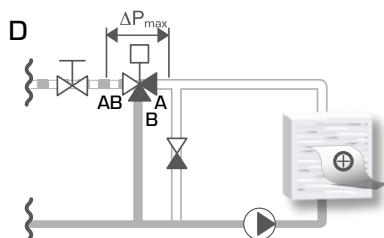

Circuit with local circulation pump

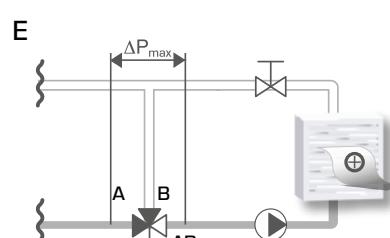

Circuit with local circulation pump